

TOWN OF OLIVE
West Shokan, N.Y. 12494

DOMENICK COVELLO
Building Inspector



P.O. Box 180
West Shokan, N.Y.
12494 657-2015

JOHN H. INGRAM
BUILDING INSPECTOR

WOODSTOVE/FIREPLACE/CHEMINY APPLICATION
UL APPROVED STOVE PERMISSIBLE ONLY

OWNER: _____
ADDRESS: _____

PHONE: _____
SIGNATURE: _____
DATE: _____
FIRE #: _____

PERSON INSTALLING AND/OR BUILDING: _____
ADDRESS: _____

PHONE: _____

DATE OF INSTALLATION: _____

MAKE OF STOVE: _____

MODEL OF STOVE: _____

IDENTIFICATION OF SUBJECT PROPERTY

LOCATION: _____

TAX MAP DESIGNATION: SECTION _____ BLOCK _____ LOT _____

ESTIMATED COST: _____

PERMIT FEE \$25.00

PERMIT EXPIRES _____

DATE OF APPROVAL _____

BUILDING INSPECTOR _____

John Ingram
Domenick Covello

WOOD STOVE/PELLET STOVE/FIREPLACE/CHIMNEY

OWNER _____ DATE _____

INSPECTED _____ INSPECTOR _____

BUILDING: BRICK _____ FRAME _____ STORIES _____ EGRESS _____

FAMILIES _____ TYPE OF HEAT _____ FUEL _____

HOT WATER _____

****ANY "NO" ANSWER SERVES AS INDICATION OF LESS THAN SAFE CONDITIONS OR DESIRABLE CONDITION. THEY SHOULD BE SATISFACTORILY CORRECTED BEFORE APPROVAL IS GIVEN

YES NO


- ____ _ 1. IS THE STOVE IN SOUND CONDITION: NEW ___ USED ___
OLD ___ POSSIBLE UNSAFE CONDITION _____
- ____ _ 2. LOCATION: IS THE STOVE LOCATED SO THAT IT WILL NOT BLOCK ANY EXITS, DOORS, PASSAGE WAYS?
- ____ _ 3. ARE PROPER TOOLS AVAILABLE FOR OPERATION: POKER ___ ASH BUCKET ___ SHOVEL ___ FIRE EXTINGUISHER _____
- ____ _ 4. ARE THERE SMOKE OR IONIZATION DETECTORS PROPERLY PLACE IN THE DWELLING?
- ____ _ 5. CLEARANCES: IS THE STOVE LOCATED 36" FROM COMBUSTIBLE SURFACES: FRONT _____, SIDE _____, REAR _____
- ____ _ 6. IF THIS CLEARANCE IS LESS THAN 36" IS THE COMBUSTIBLE WALL PROTECTED?
- ____ _ 7. IF PROTECTED, IS THE CLEARANCE IN COMPLIANCE WITH MANUFACTURERS APPROVED RECOMMENDATIONS? OWNER TO CHECK AND MAKE REQUIRED CORRECTION
- ____ _ 8. IS THE STOVE PIPE THE SAME SIZE OR LARGER THAT APPLIANCE FLUE CONNECTION?
- ____ _ 9. IS THE STOVE PIPE ASSEMBLED SO THAT THE CRIMPED END POINTS TOWARD THE STOVE SO THAT THE CREOSOTE AND MOISTURE WILL STAY INSIDE THE PIPE AND RUN BACK TO THE STOVE, RATHER THAN RUN OUTSIDE?
****NOTE:** IT MAY BE NECESSARY TO MAKE AN ADAPTOR OF 24 GAUGE OR HEAVIER PIPE TO ALLOW CRIMPED END TOWARD THE STOVE.

CONTINUED ON OTHER SIDE

YES NO

- ___ 10. DO ALL HORIZONTAL RUNS OR STOVE PIPE RISE FROM THE STOVE TOWARD THE CHIMNEY?
****NOTE: NFPA RECOMMENDS 1/4" PER RT.**
- ___ 11. DOES THAT STOVE PIPE AVOID EXTENDING THROUGH ANY FLOOR OR CEILING?
- ___ 12. ARE ALL JOINTS SECURED WITH CLAMPS OR SHEET METAL SCREWS?
- ___ 13. ARE ALL SECTION OF STOVE PIPES 18" OR MORE FROM COMBUSTIBLES?
- ___ 14. IS THE CHIMNEY A SUITABLE MASONRY CHIMNEY OR LISTED CLASS "A" FACTORY BUILT CHIMNEY_____
- ___ 15. IS THERE 1" CLEARANCE FROM WOOD TO MASONRY CHIMNEY IF ON EXTENSION?
- ___ 16. IS THERE 2" CLEARANCE FROM WOOD TO MASONRY CHIMNEY IF ON INTERIOR?
- ___ 17. DOES THE CHIMNEY EXTEND AT LEAST 3 FEET ABOVE THE ROOF?
- ___ 18. DOES THE CHIMNEY EXTEND AT LEAST 2 FEET THAN ANYTHING WITHIN 10 FEET?
- ___ 19. IS THERE AT LEAST 12" OF MASONRY ABOUT THE PERIMETER OF THE THIMBLE?
- ___ 20. IS THERE A CLEAN OUT LOCATED AT THE BASE OF THE CHIMNEY?
- ___ 21. IS THE CLEAN OUT LOCATED AT THE BASE OF FACTORY BUILT CHIMNEY?
- ___ 22. IS THERE A 5/8" FIRE CLAY LINER IN THE MASONRY CHIMNEY?
- ___ 23. IS ONLY ONE NATURAL DRAFT BURNER ON THE FLUE?
- ___ 24. IS THE CHIMNEY SEPARATE FROM THE ONE USED FOR VENTING CONVENTIONAL OIL OR GAS FURNACES?

NFPA Minimum Clearances For Safe Installation

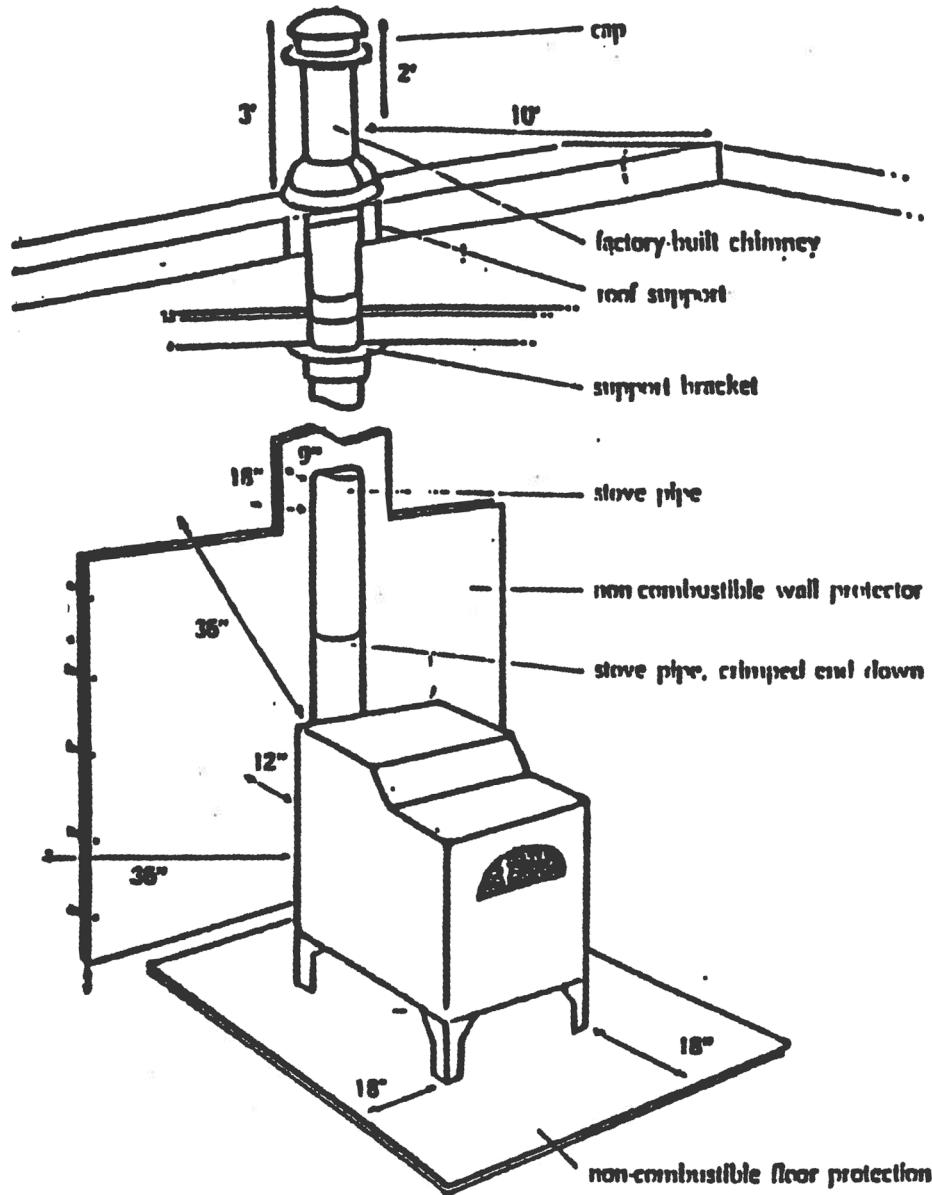

From	Combustibles	With 3½" masonry wall or 24 gauge sheet metal with 1" airspace
A. Listed Wood Heater		
Front	36"	—
Side, Back	36"	12"
Top	36"	12"
B. Single Wall Connector Pipe (24 gauge or heavier)	18"	9"
C. Chimney Height	3 feet higher than roof; 2 feet higher than any part of roof within 10 feet (measured horizontally).	